
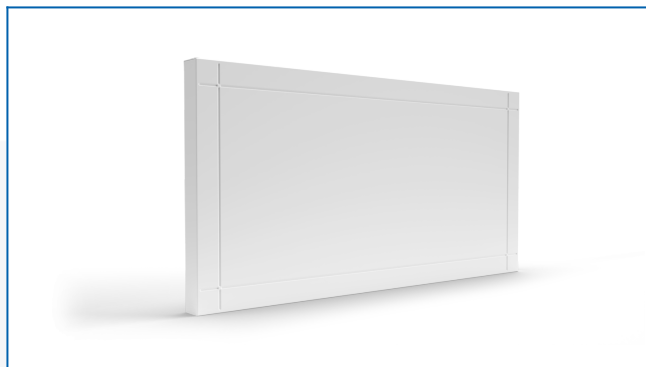


KORAWALL WI

Wall mounted convectors with optimized convection

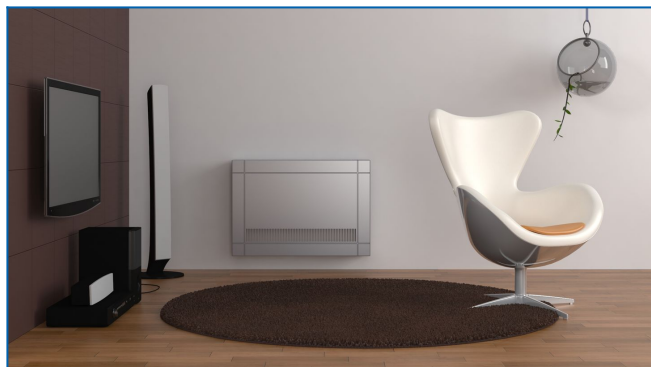

Entered filters

Heat output: t_1 : 75 °C | t_2 : 65 °C | t_i : 20 °C | Δt : 50 °C

